

This Addendum must be signed and either emailed to pwitcher@mce.us.com or faxed back to the office of McClelland Consulting Engineers, Inc. at (501) 371-9932 to acknowledge receipt 24 hours prior to the bid opening.

Signature: _____

Company: _____

ADDENDUM NO. 1

DATE: MAY 15, 2024

RE: CITY OF CORNING, ARKANSAS – CONSTRUCT HELIPAD – 24-5724

FROM: McClelland Consulting Engineers, Inc.
7302 Kanis Road
Little Rock, Arkansas 72204
Phone: 501/371-0272

TO: PROSPECTIVE BIDDERS:


This Addendum forms a part of the Contract Documents and modifies the original Bidding Documents dated **May 3, 2024** as noted below. Acknowledge receipt of the Addendum in the space provided on the Bid Form. Failure to do so may subject the Bidder to disqualification.

This Addendum consists of 2 page(s).

PLANS

1. Sheet 12 – MISCELLANEOUS DETAILS III
 - Replace Sheet 12 MISCELLANEOUS DETAILS III with attached revised Sheet 12 MISCELLANEOUS DETAILS. Sheet includes updated wind cone foundation detail to no longer include box and L-830 transformer.


END OF ADDENDUM

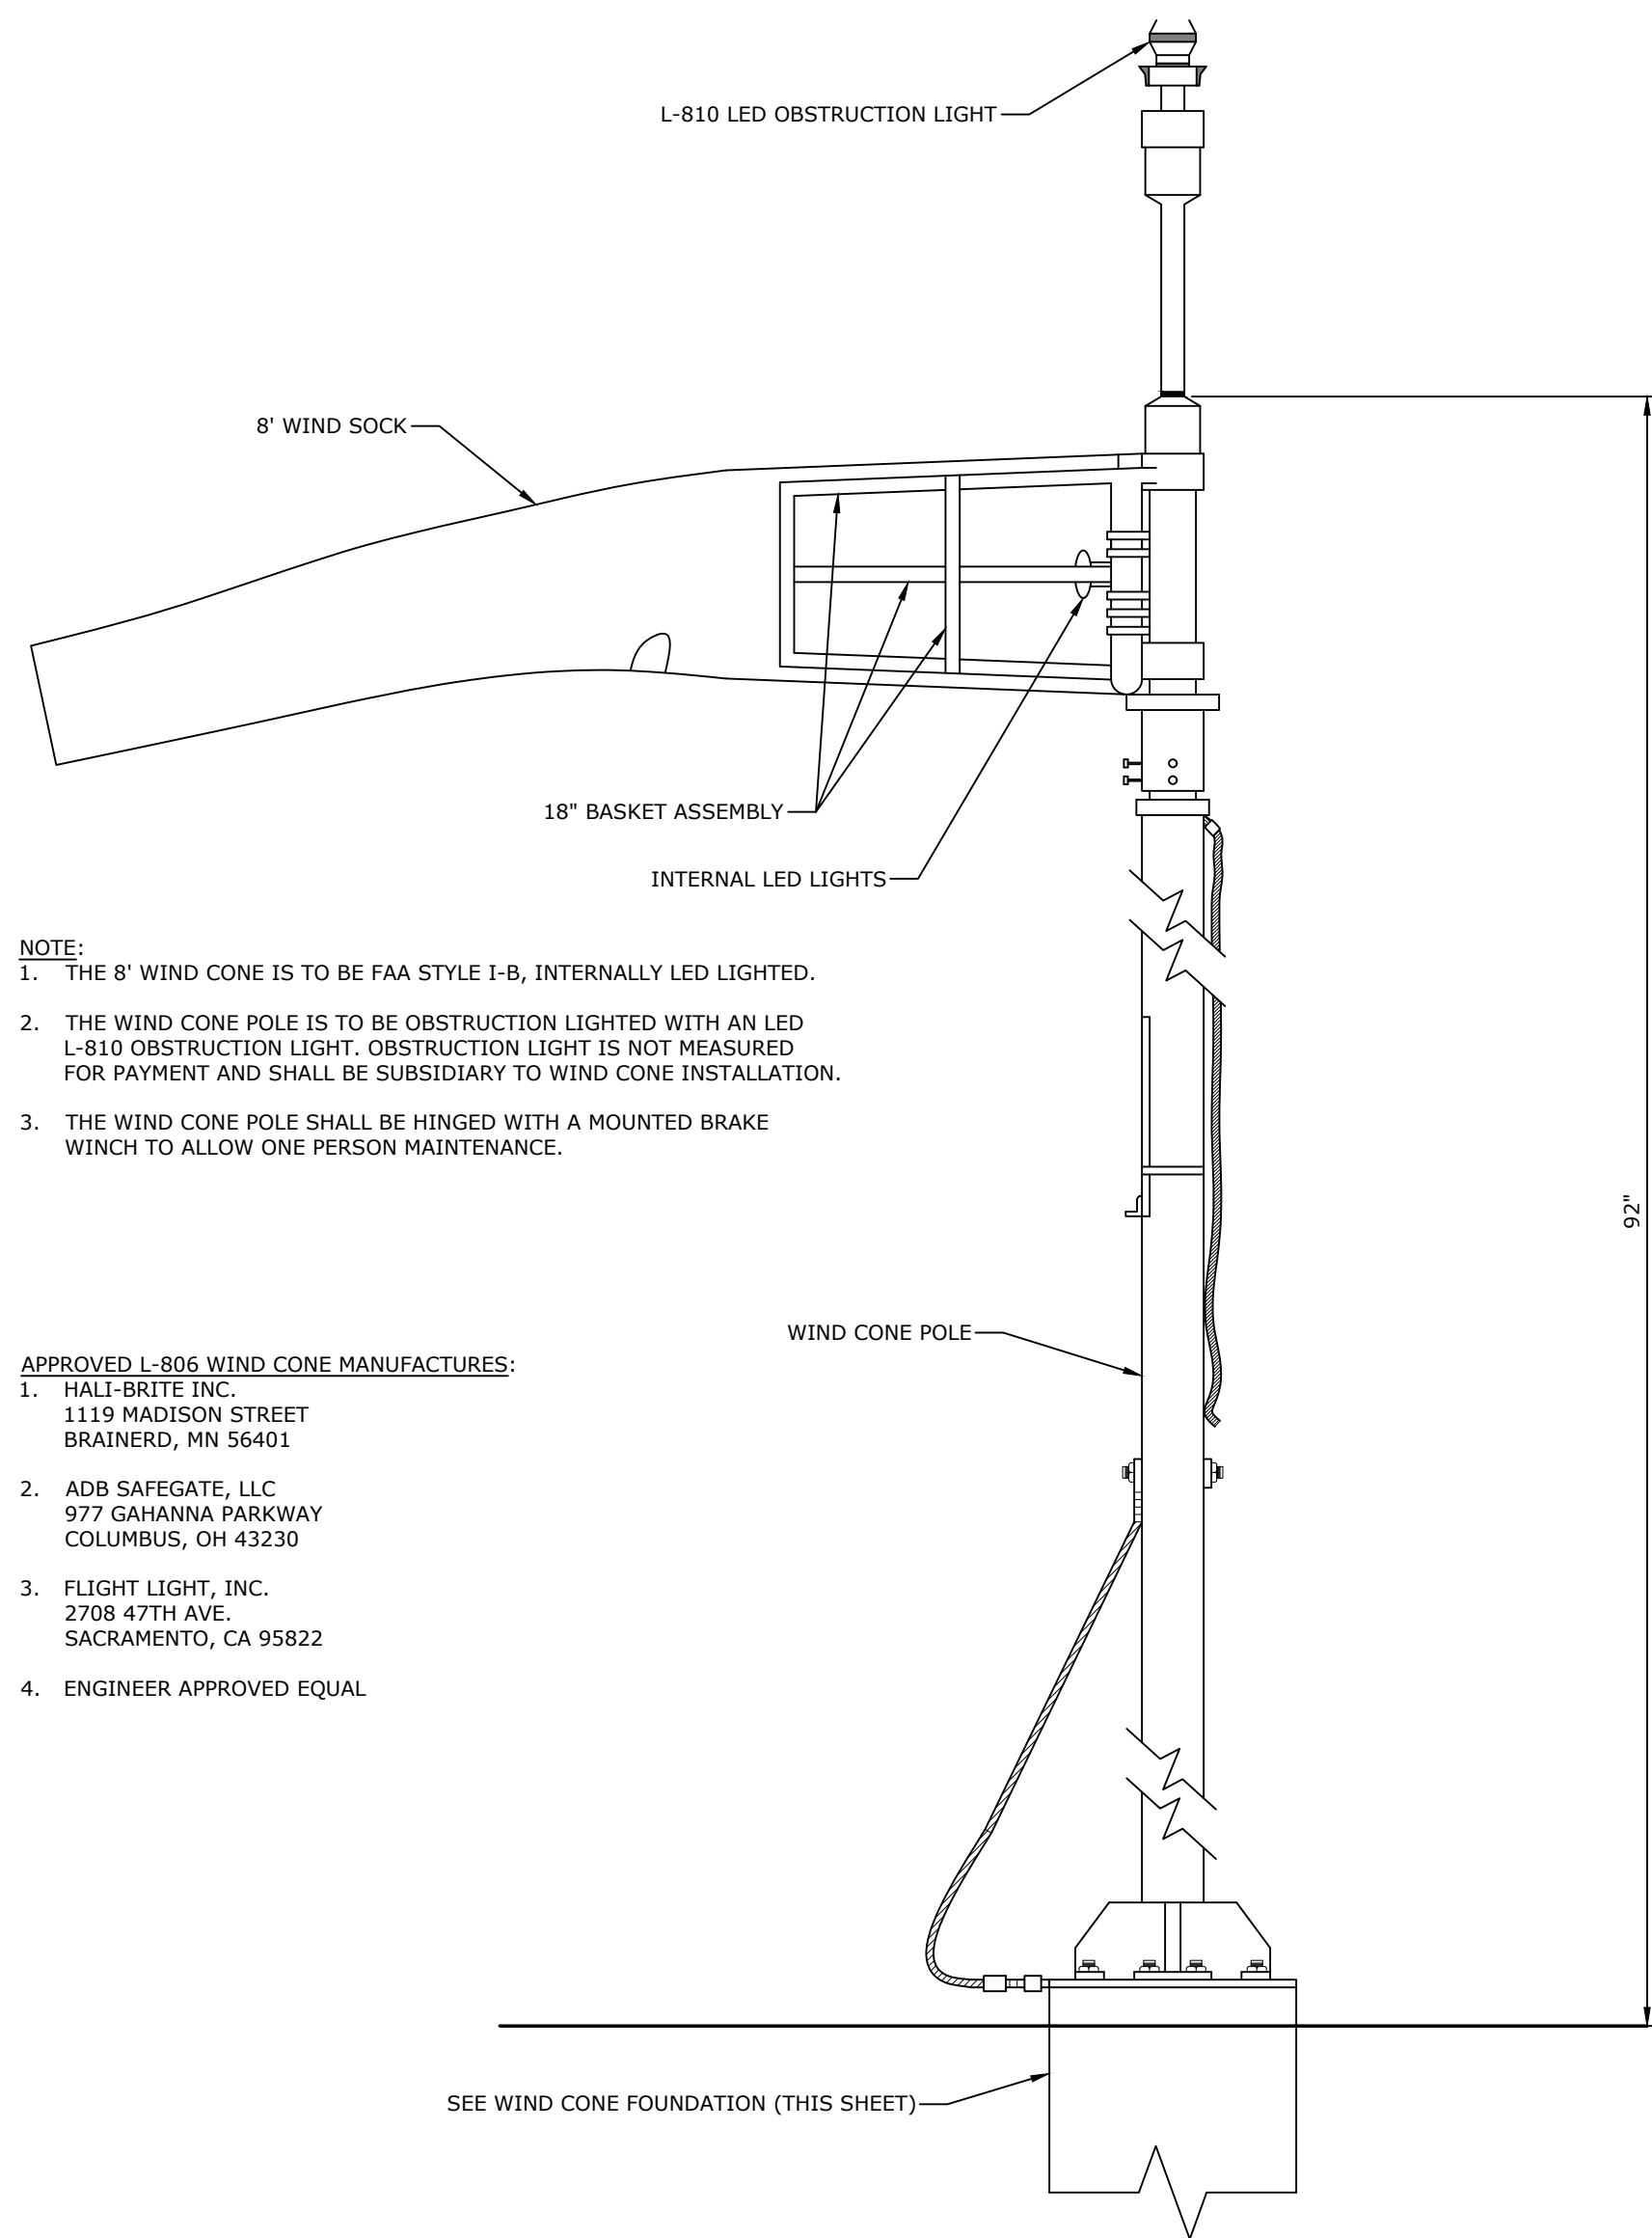

- NOTE:**
1. THE 8' WIND CONE IS TO BE FAA STYLE I-B, INTERNALLY LED LIGHTED.
 2. THE WIND CONE POLE IS TO BE OBSTRUCTION LIGHTED WITH AN LED L-810 OBSTRUCTION LIGHT. OBSTRUCTION LIGHT IS NOT MEASURED FOR PAYMENT AND SHALL BE SUBSIDIARY TO WIND CONE INSTALLATION.
 3. THE WIND CONE POLE SHALL BE HINGED WITH A MOUNTED BRAKE WINCH TO ALLOW ONE PERSON MAINTENANCE.


- APPROVED L-806 WIND CONE MANUFACTURERS:**
1. HALL-BRITE INC.
1119 MADISON STREET
BRainerD, MN 56401
 2. ADB SAFEGATE, LLC
977 GAHANNA PARKWAY
COLUMBUS, OH 43230
 3. FLIGHT LIGHT, INC.
2708 47TH AVE.
SACRAMENTO, CA 95822
 4. ENGINEER APPROVED EQUAL

TYPE L-806 WIND CONE DETAIL
N.T.S.

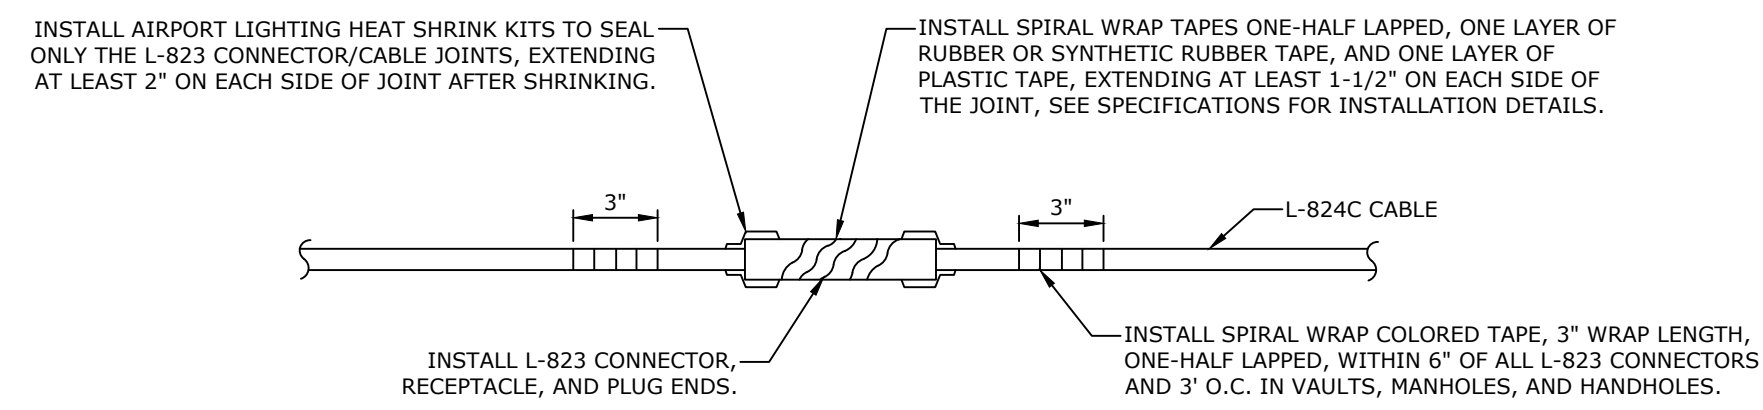


- NOTES:**
1. COLOR CODE CIRCUITS IN THE VAULT, IN EACH HANDHOLE AND MANHOLE, AND IN EACH BASE MOUNTED LIGHT.
 2. COLOR CODE CIRCUITS AT EACH SPLICE LOCATION.
 3. COORDINATE COLOR SELECTION WITH OWNER AND ENGINEER.

L-823 CONNECTOR INSTALLATION DETAIL
N.T.S.

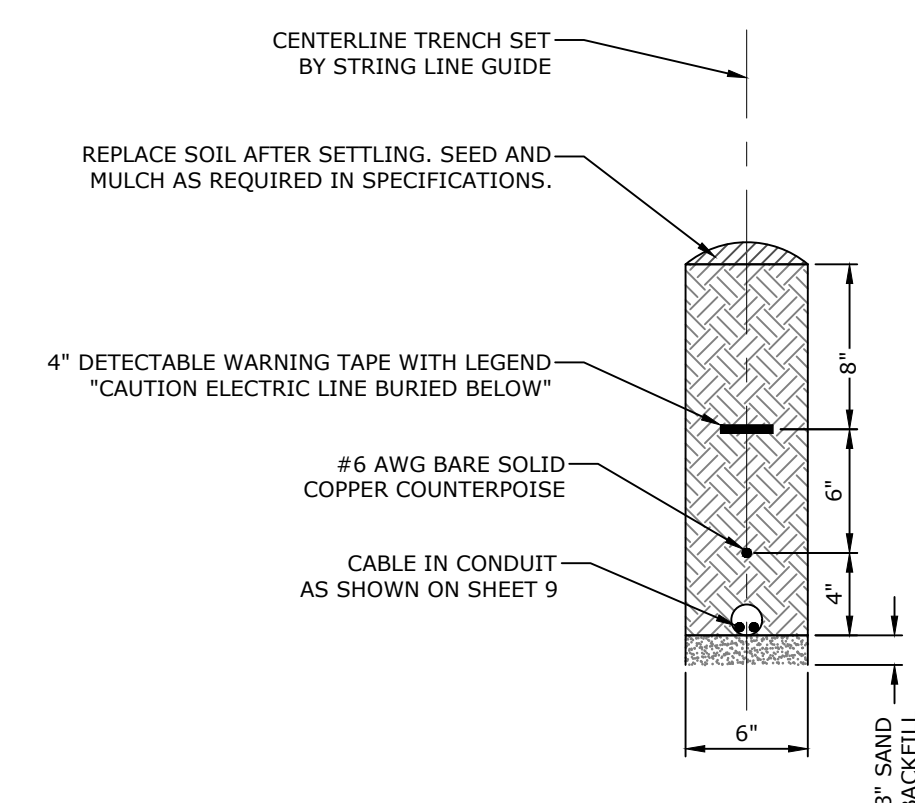


CONDUIT TRENCH DETAIL
N.T.S.

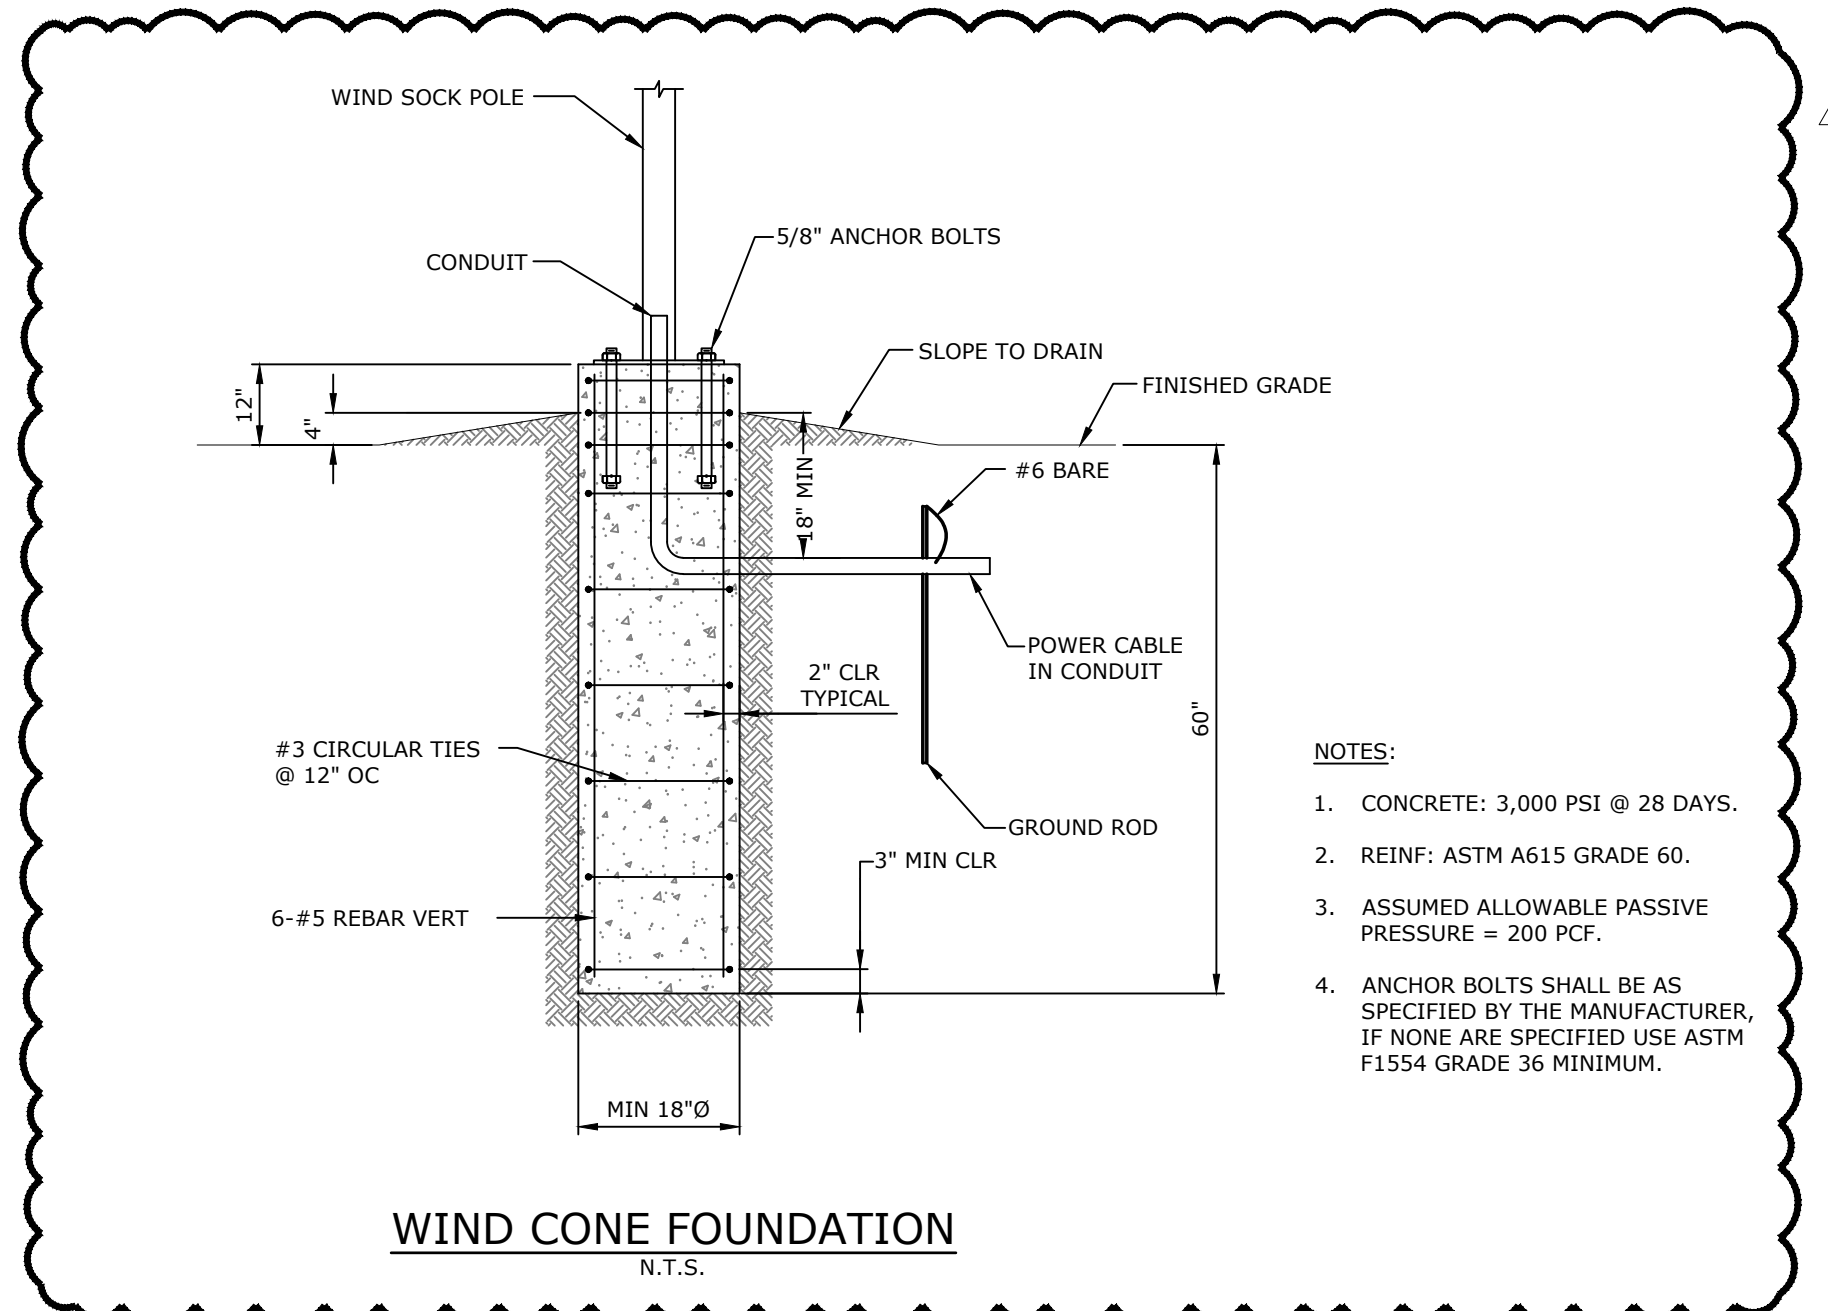

- NOTES:**
1. CONCRETE: 3,000 PSI @ 28 DAYS.
 2. REINF: ASTM A615 GRADE 60.
 3. ASSUMED ALLOWABLE PASSIVE PRESSURE = 200 PCF.
 4. ANCHOR BOLTS SHALL BE AS SPECIFIED BY THE MANUFACTURER, IF NONE ARE SPECIFIED USE ASTM F1554 GRADE 36 MINIMUM.


WIND CONE FOUNDATION
N.T.S.

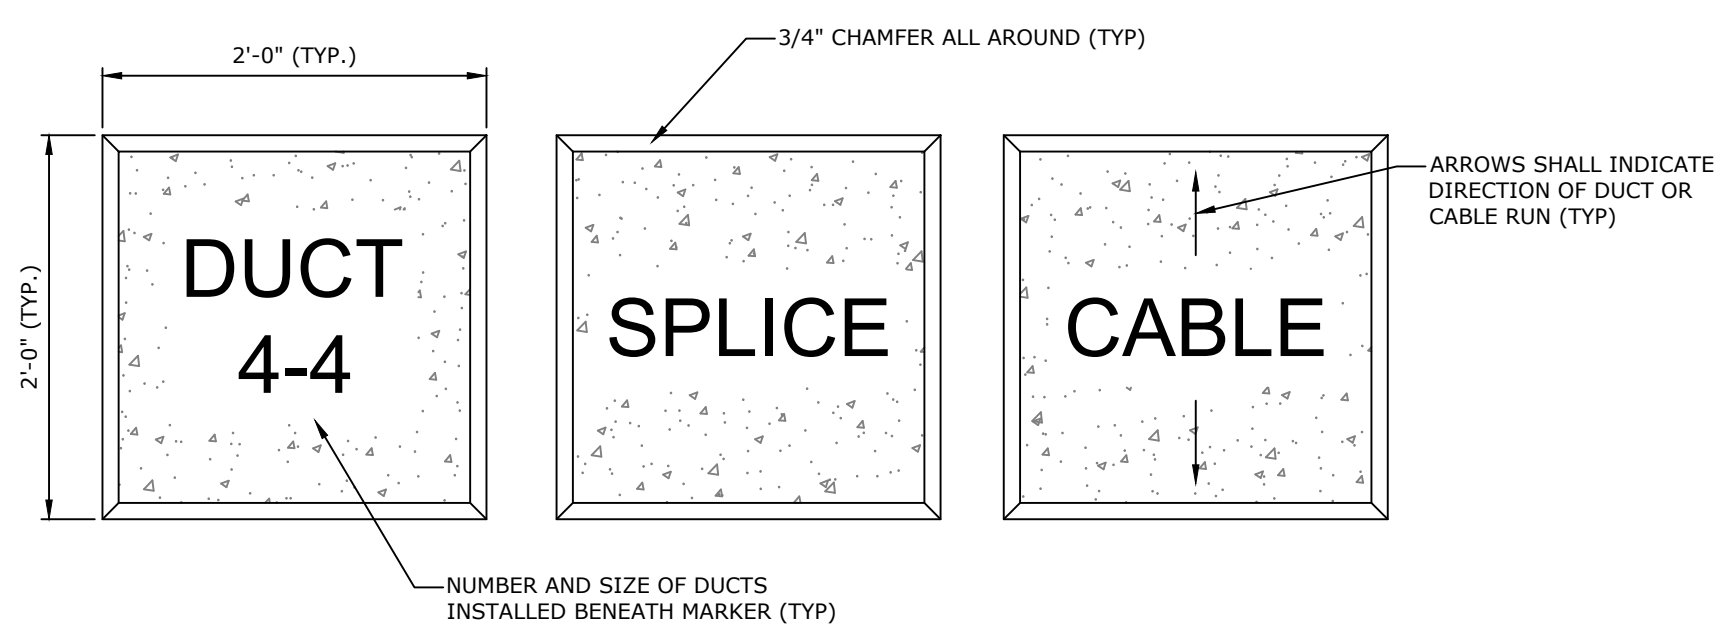

- NOTES:**
1. LETTERS SHALL BE 4" HIGH, 3" WIDE, STROKE 1/2" WIDE, IMPRESSED 1/4" DEEP, LETTERS SHALL BE STENCILED.
 2. MARKERS SHALL BE 4" THICK MINIMUM AND PROJECT 1" A.F.G. MAXIMUM.
 3. MARKERS SHALL BE PAINTED AVIATION ORANGE.
 4. STERILIZE SOIL 2' ALL AROUND.
 5. COST OF CONCRETE MARKERS IS INCIDENTAL TO THE ASSOCIATED ITEMS OF DUCT OR CABLE.
 6. CABLE AND SPLICE MARKERS SHALL IDENTIFY THE CIRCUITS WHICH THE CABLES BELONG TO.
 7. REFER TO PROJECT SPECIFICATIONS FOR PLACEMENT OF CONCRETE MARKERS.

CONCRETE MARKER DETAILS
N.T.S.

MCE McCLELLAND CONSULTING, INC.
DESIGNED TO SERVE ENGINEERS, INC.
7302 KANIS ROAD
LITTLE ROCK, ARKANSAS 72204
(501) 371-0272
HTTP://WWW.MCE.US.COM

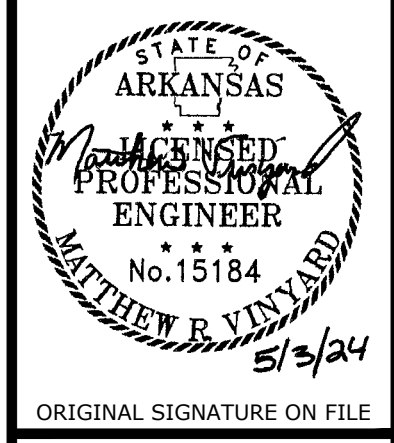

CITY OF CORNING, ARKANSAS
CONSTRUCT HELIPAD
CORNING, ARKANSAS



REV	DATE	DESCRIPTION
1	5/15/2024	ADDENDUM NO. 1

MISCELLANEOUS
DETAILS III

DESIGNED BY: JME	DRAWN BY: SJM
DATE: MAY, 2024	REVISION:
SCALE: N.T.S.	JOB NUMBER: 24-5724

W:\2024\24-5724_Corning Municipal Airport Construct Helipad\Design Drawings\Civil\24-5724_Cover.dwg, PRINTED ON: May 15, 2024 @ 2:23 PM